



# AO-44 MODIFIED WITH 6G2 PREAMP & TREMOR-LATOR

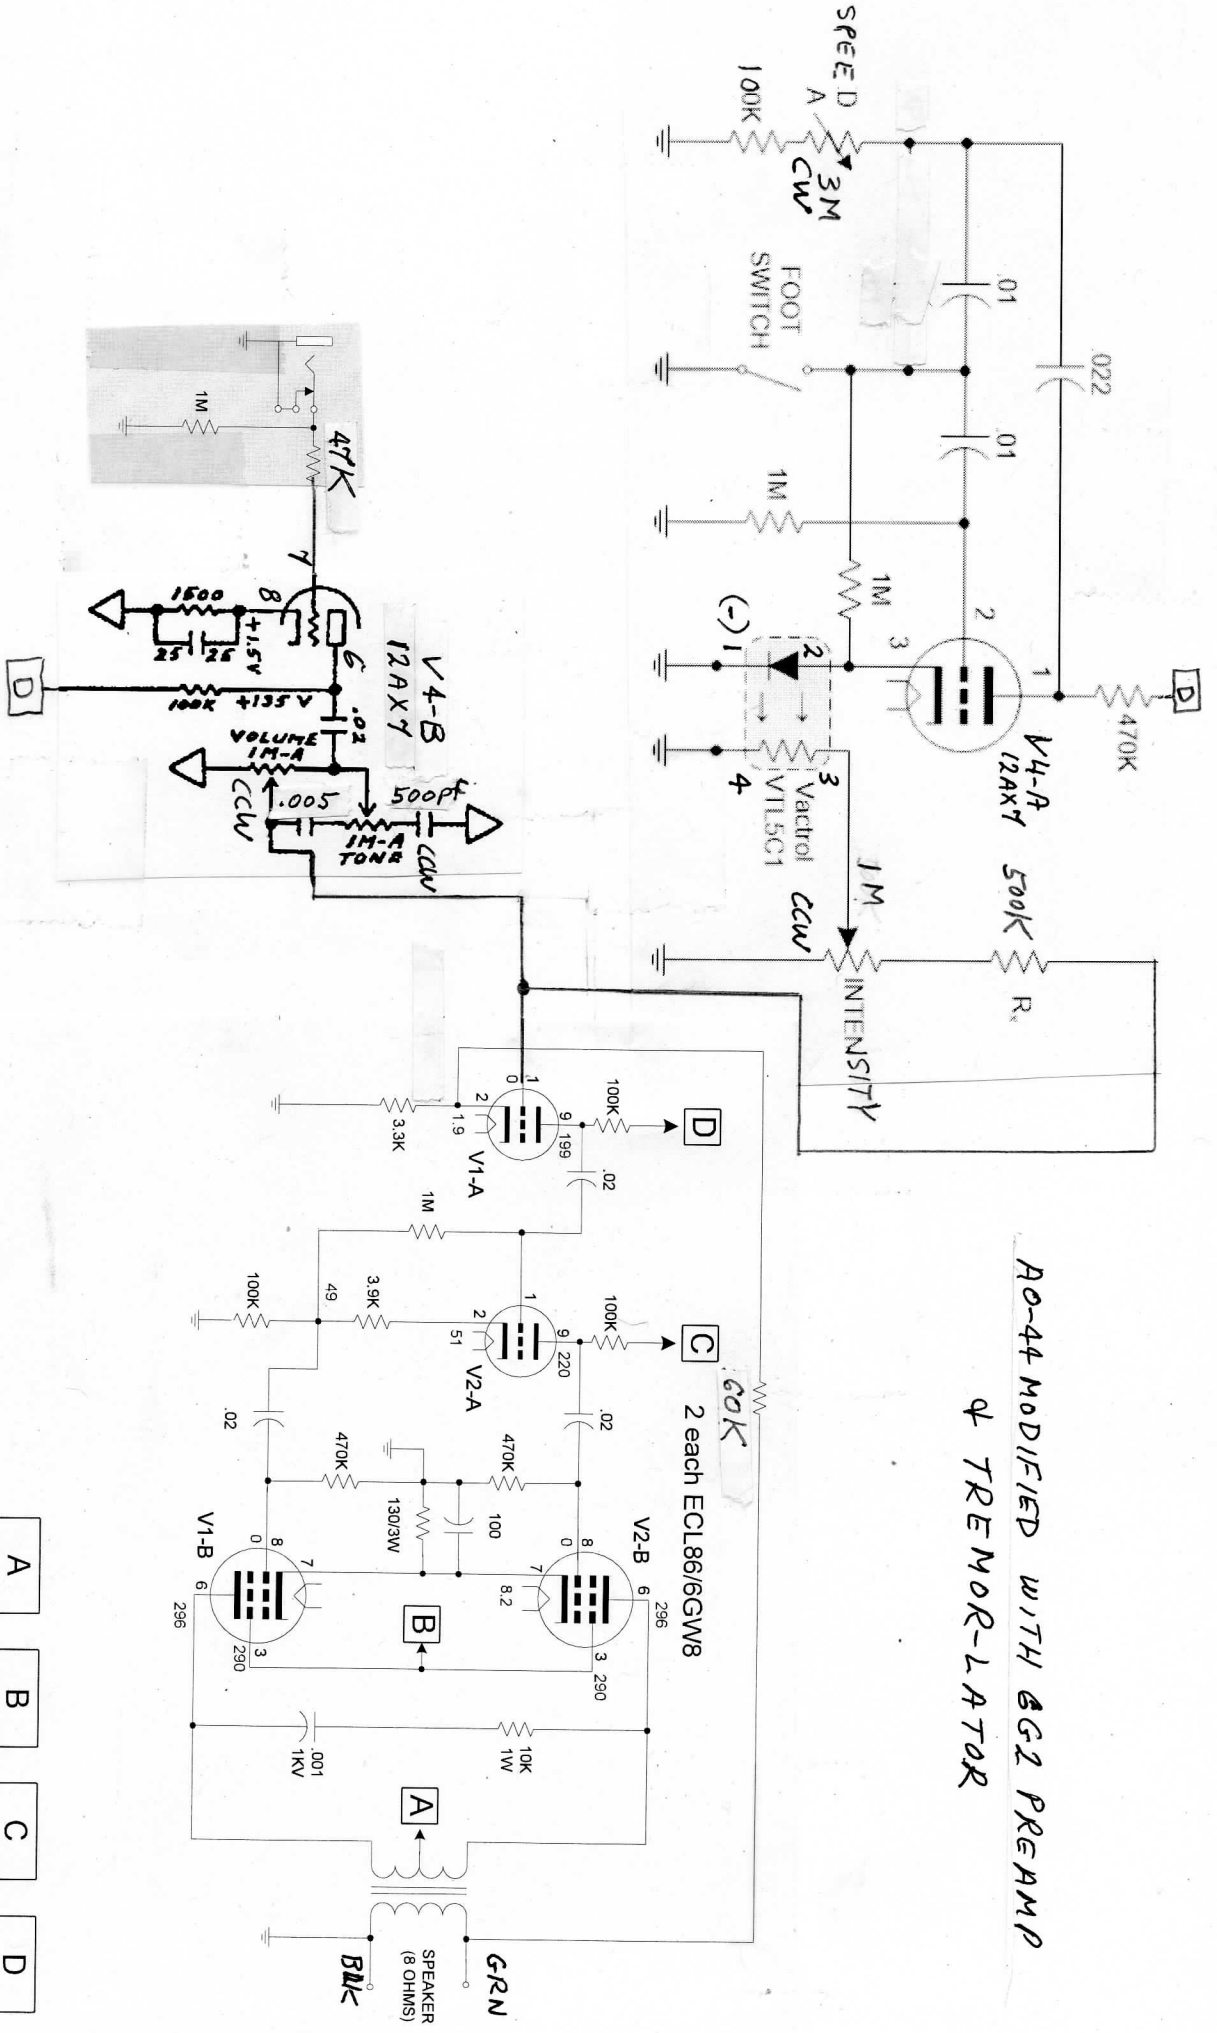

## Conversion notes

- Removed transistor circuitry and Volume Compressor.
- Power amp and power supply are completely stock AO-44 except for note 1.
- Added Fender **6G2** preamp.
- Voltages measured with Fluke 87V. Line voltage set to 120VAC.

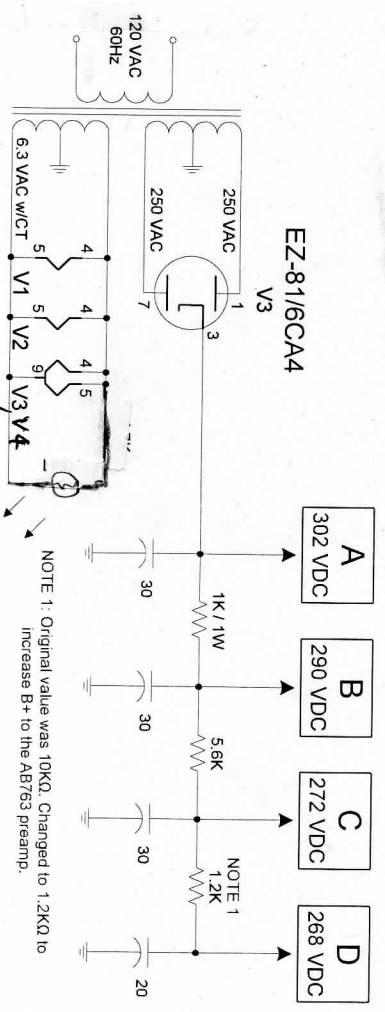

NOTE 1: Original value was 10K $\Omega$ . Changed to 1.2K $\Omega$  to increase B+ to the AB763 preamp.