AO-44 MODIFIED WITH 6G2 PREAMP
& TREMOR-LATOR

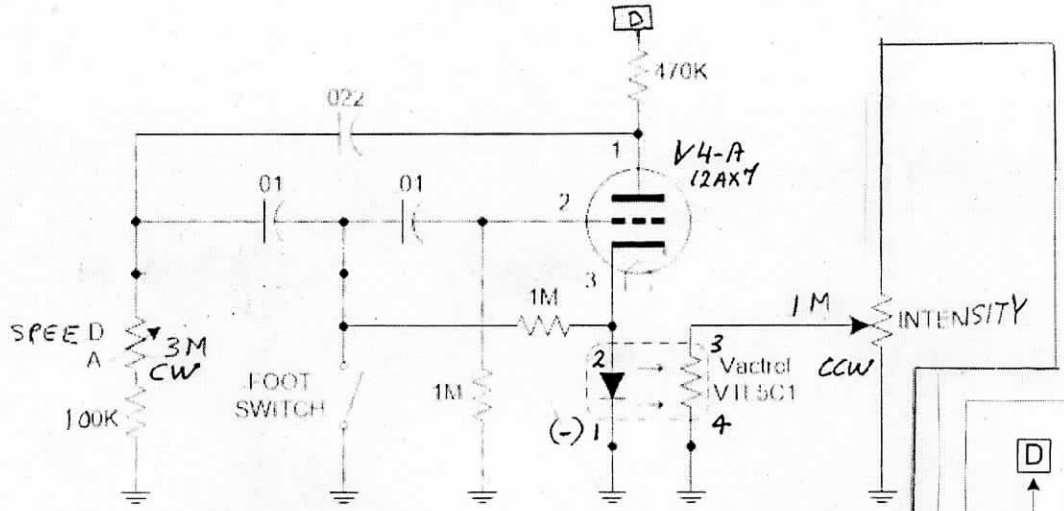

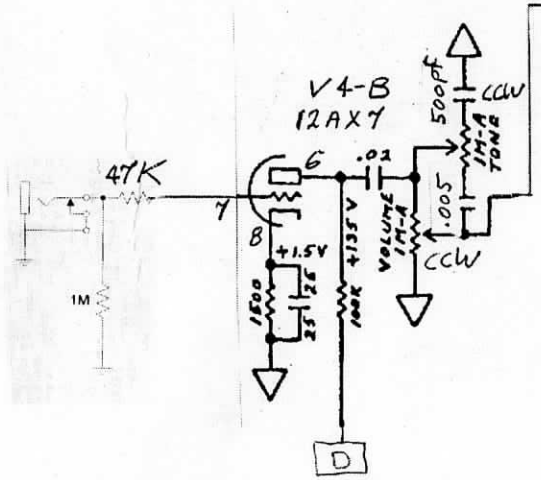

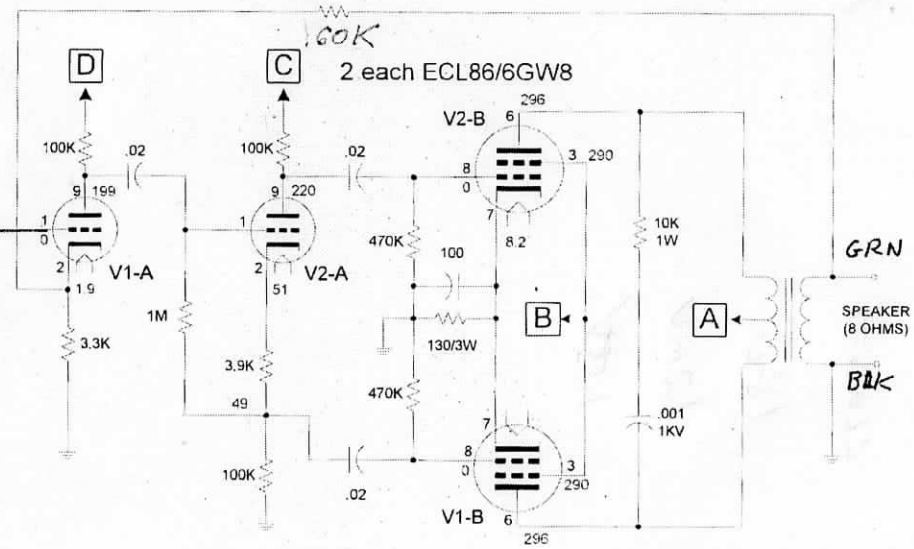

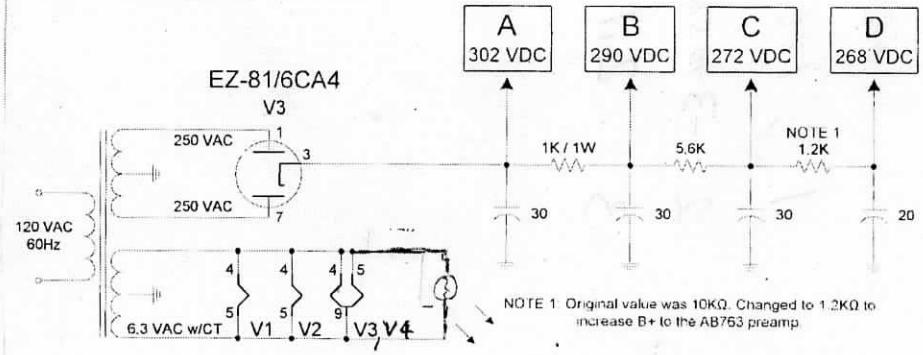

Conversion notes

- Removed transistor circuitry and Volume Compressor.
- Power amp and power supply are completely stock AO-44 except for note 1.
- Added Fender 6G2 preamp.
- Voltages measured with Fluke 87V. Line voltage set to 120VAC.